


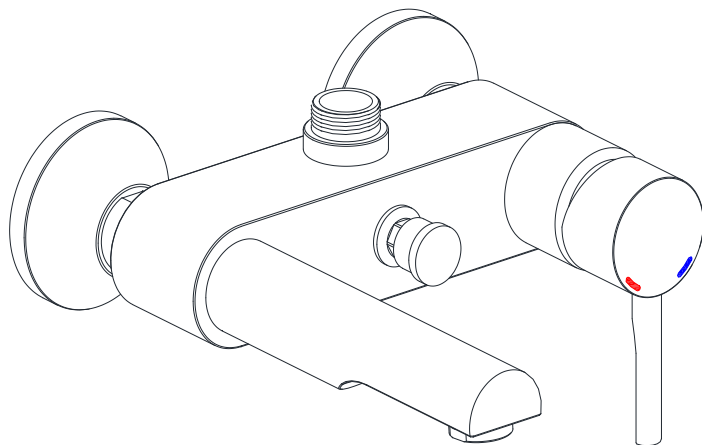


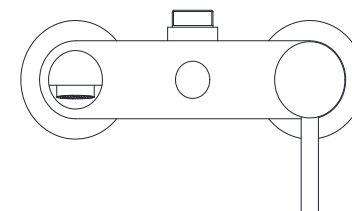

## FLP-5115PM

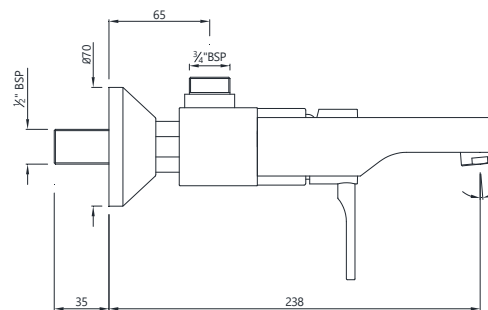


## TECHNICAL DRAWING

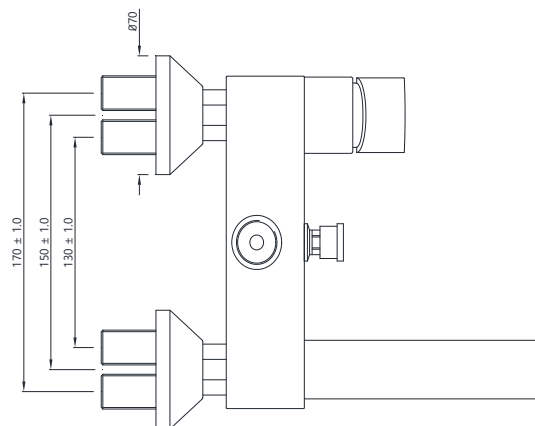







## TEMP.&amp; WATER PRESSURE REQUIREMENTS

	Working Pressure: 1~3 bar
	Required Temperature: 5-65°C

Note: Above are the recommended values for getting Conventional Output.

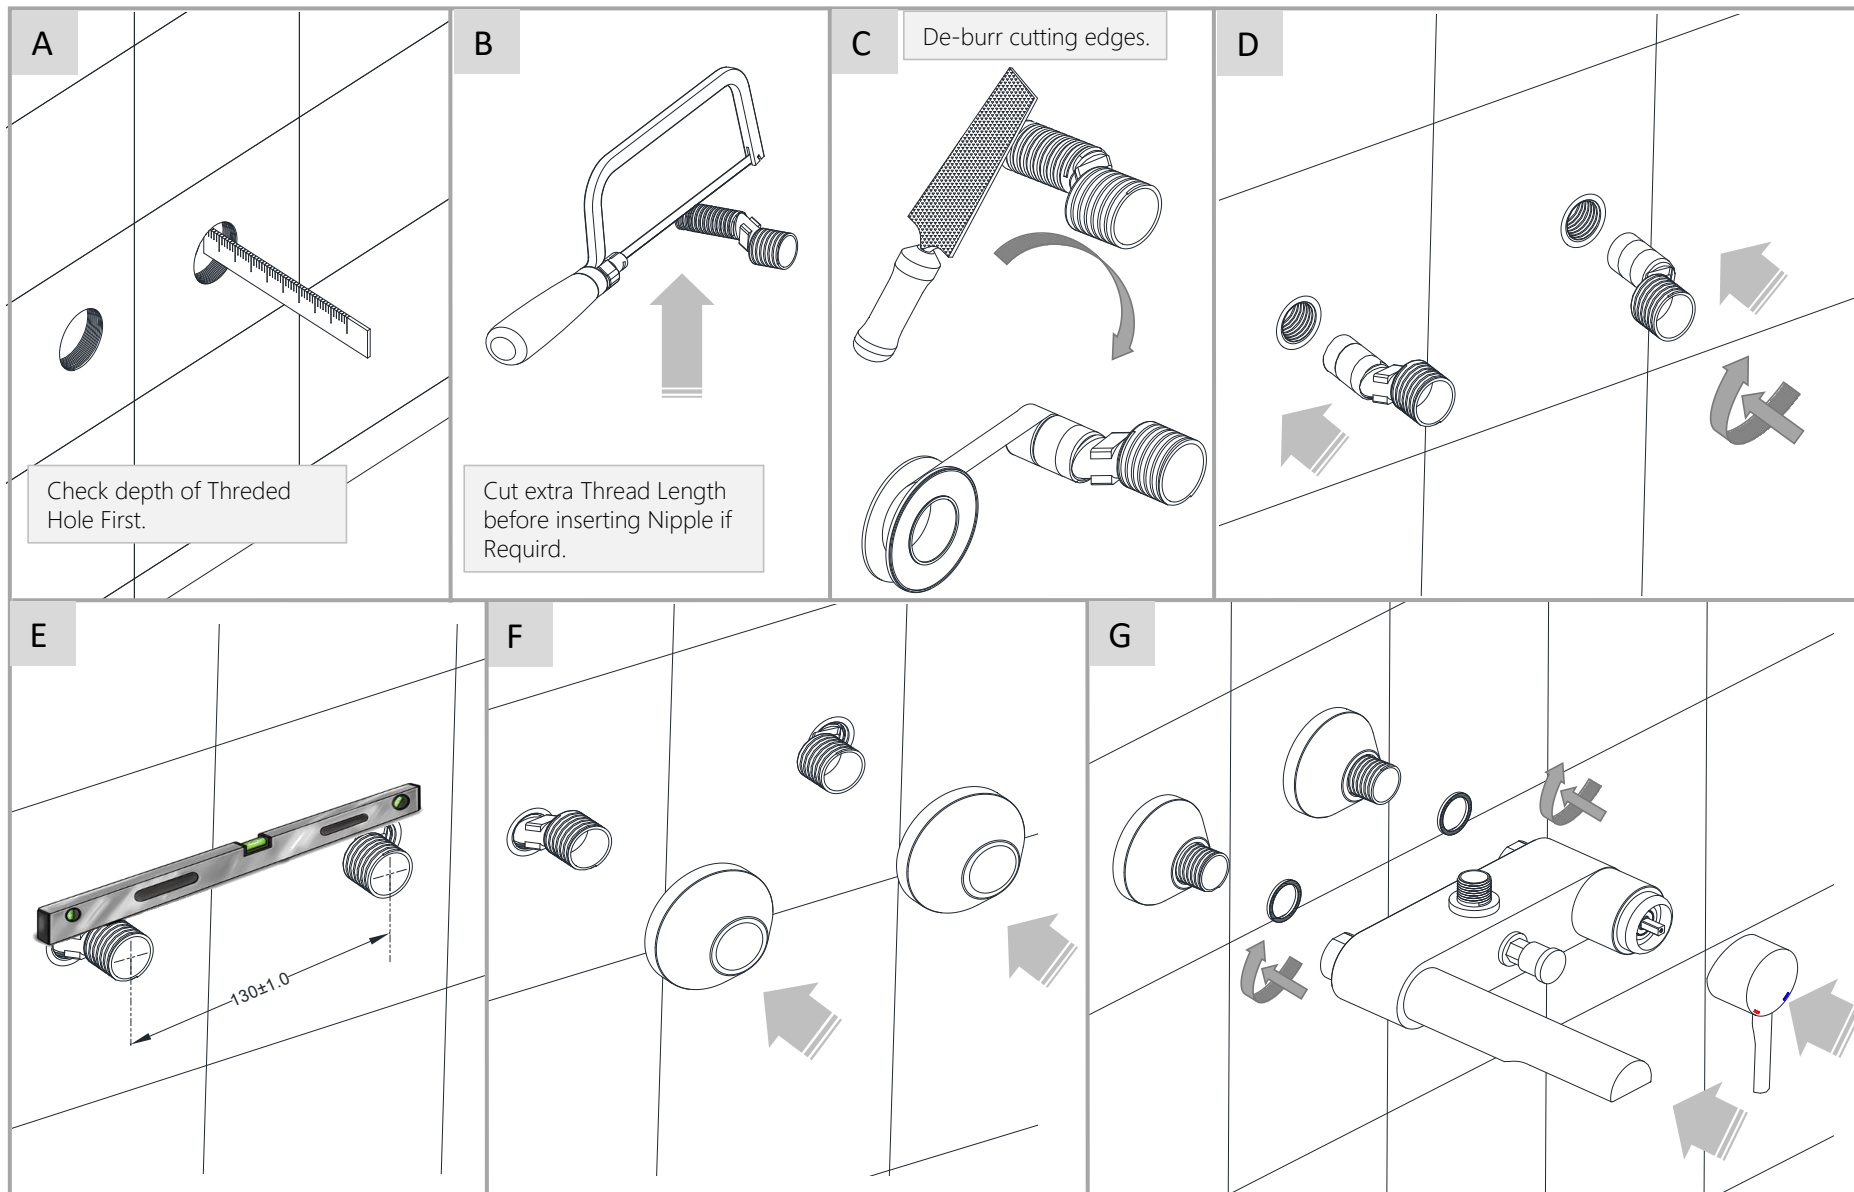

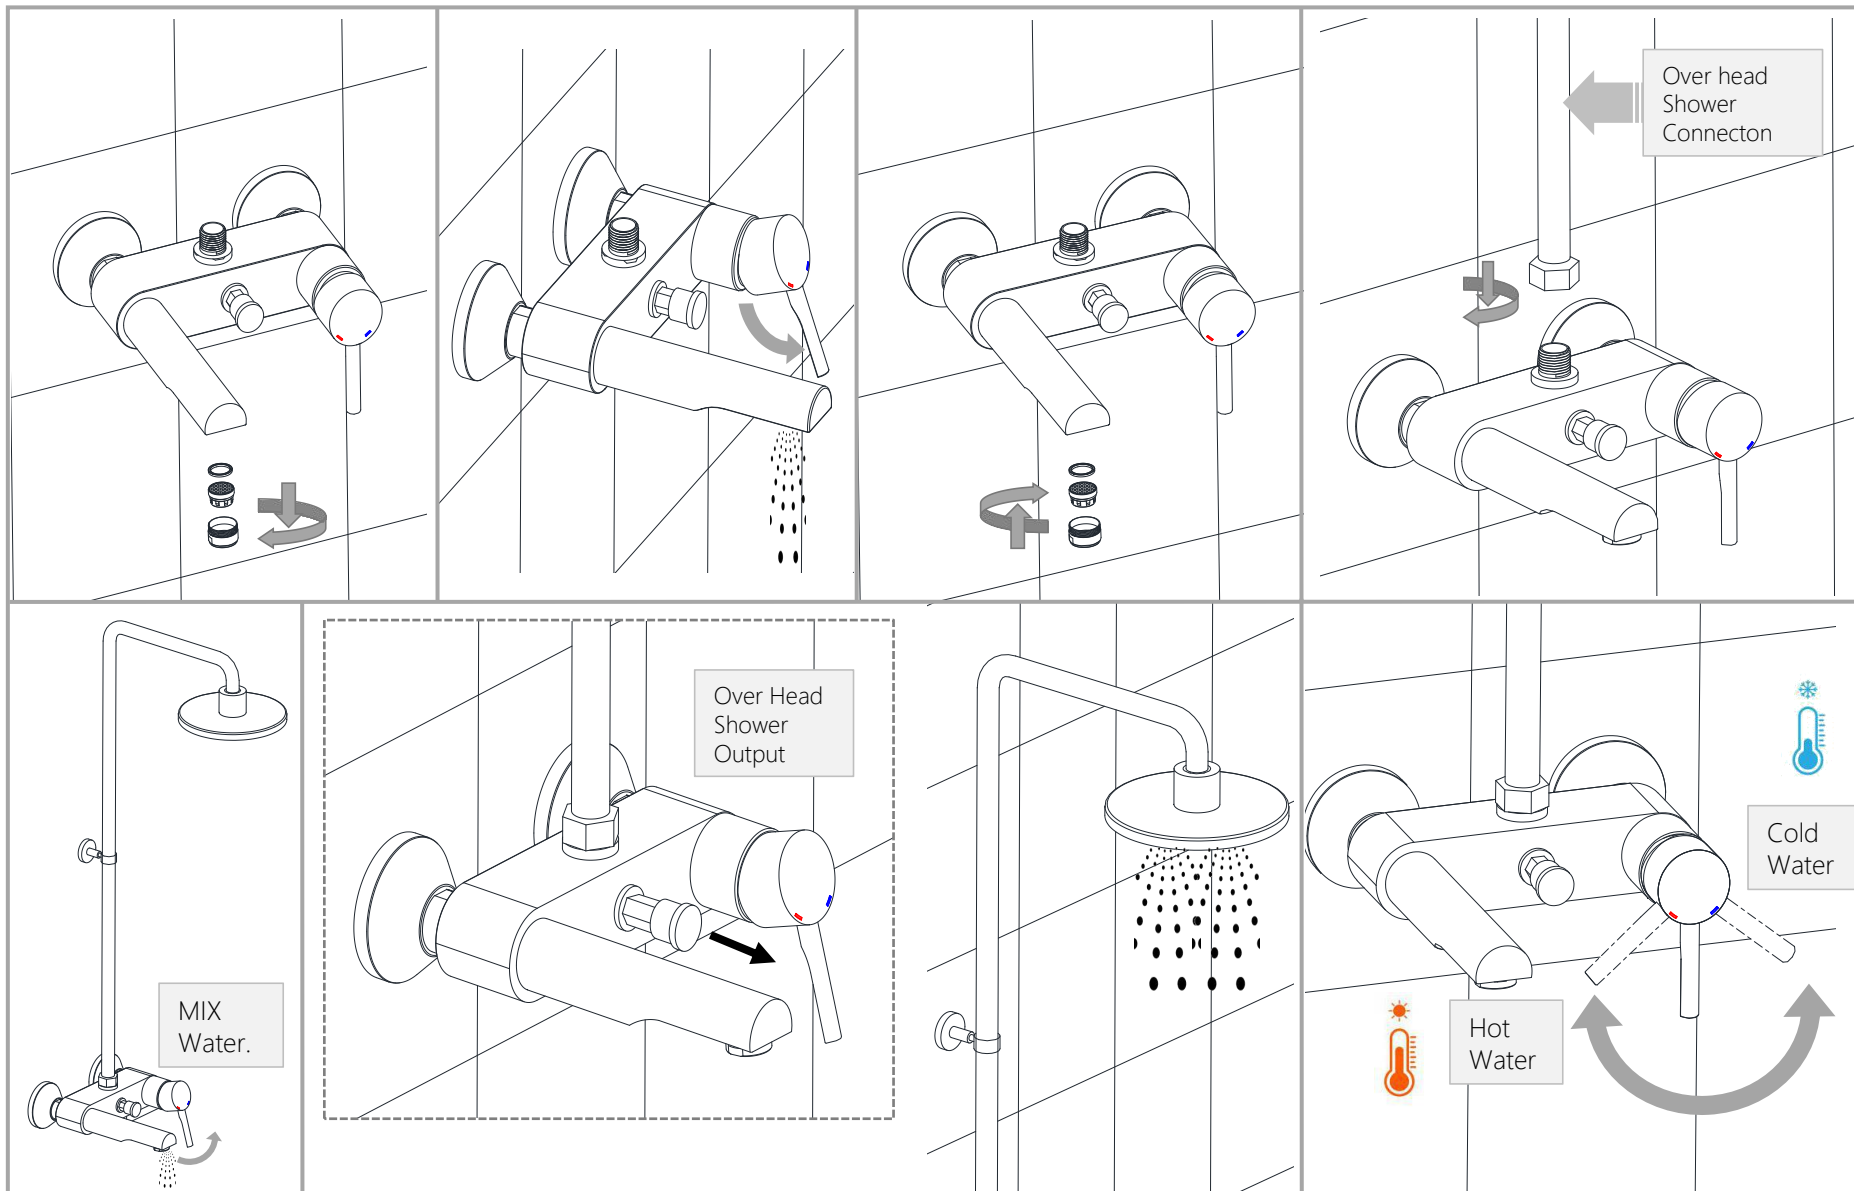

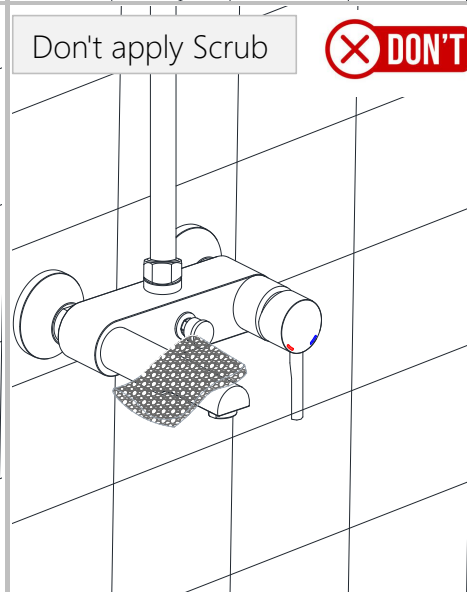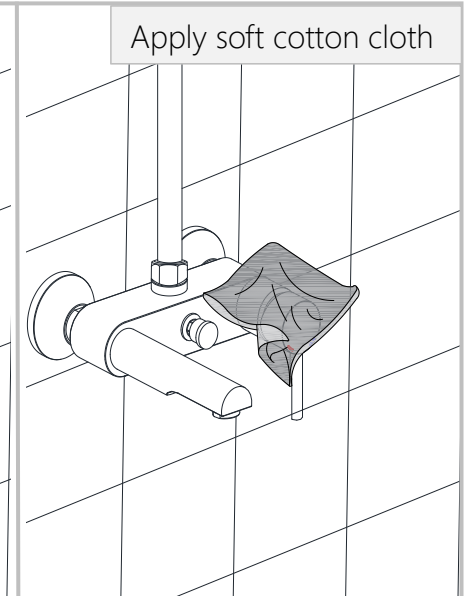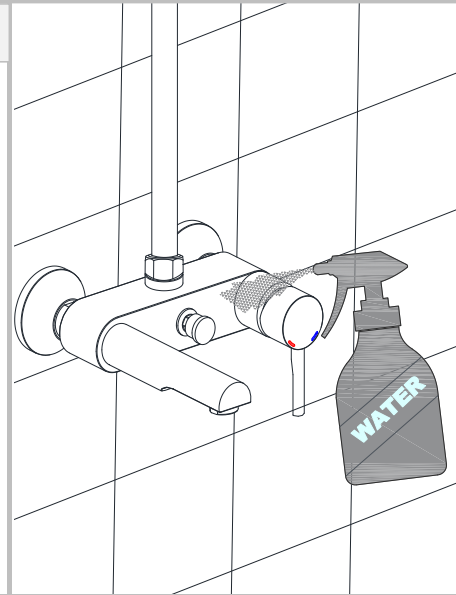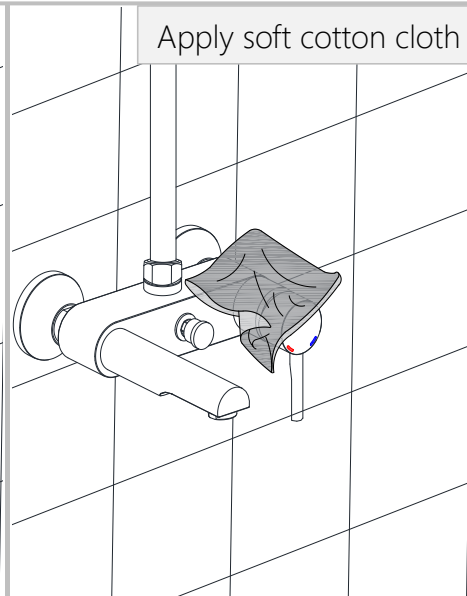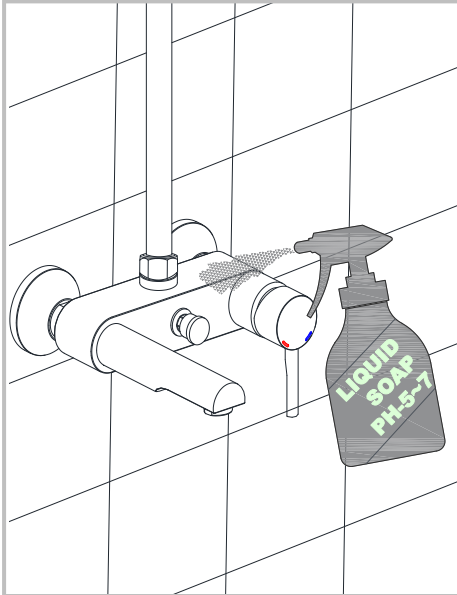

Steps & Cleaning agents requirements for Aerator Cleaning.

