
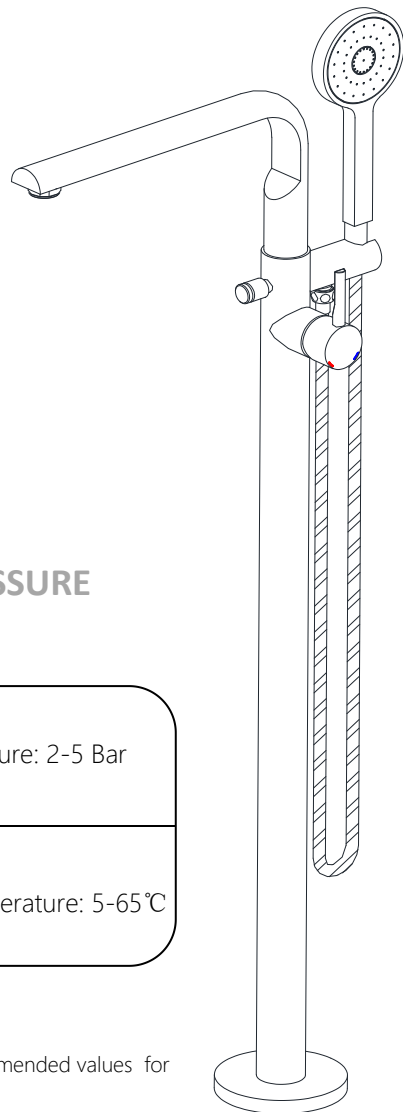




## FLP-5121KPM


TEMP.& WATER PRESSURE  
REQUIREMENTS


Working Pressure: 2-5 Bar



Required Temperature: 5-65°C


Note: Above values are the recommended values for Getting Conventional Outputs.

## TECHNICAL DRAWING


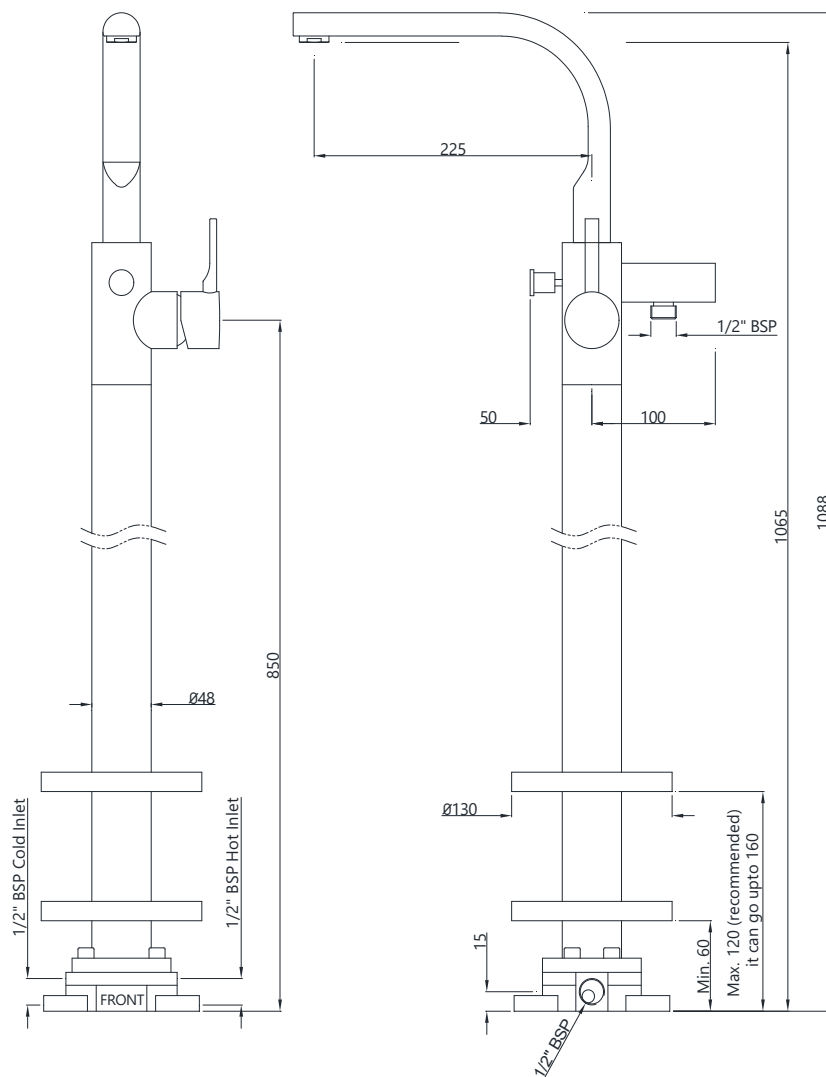


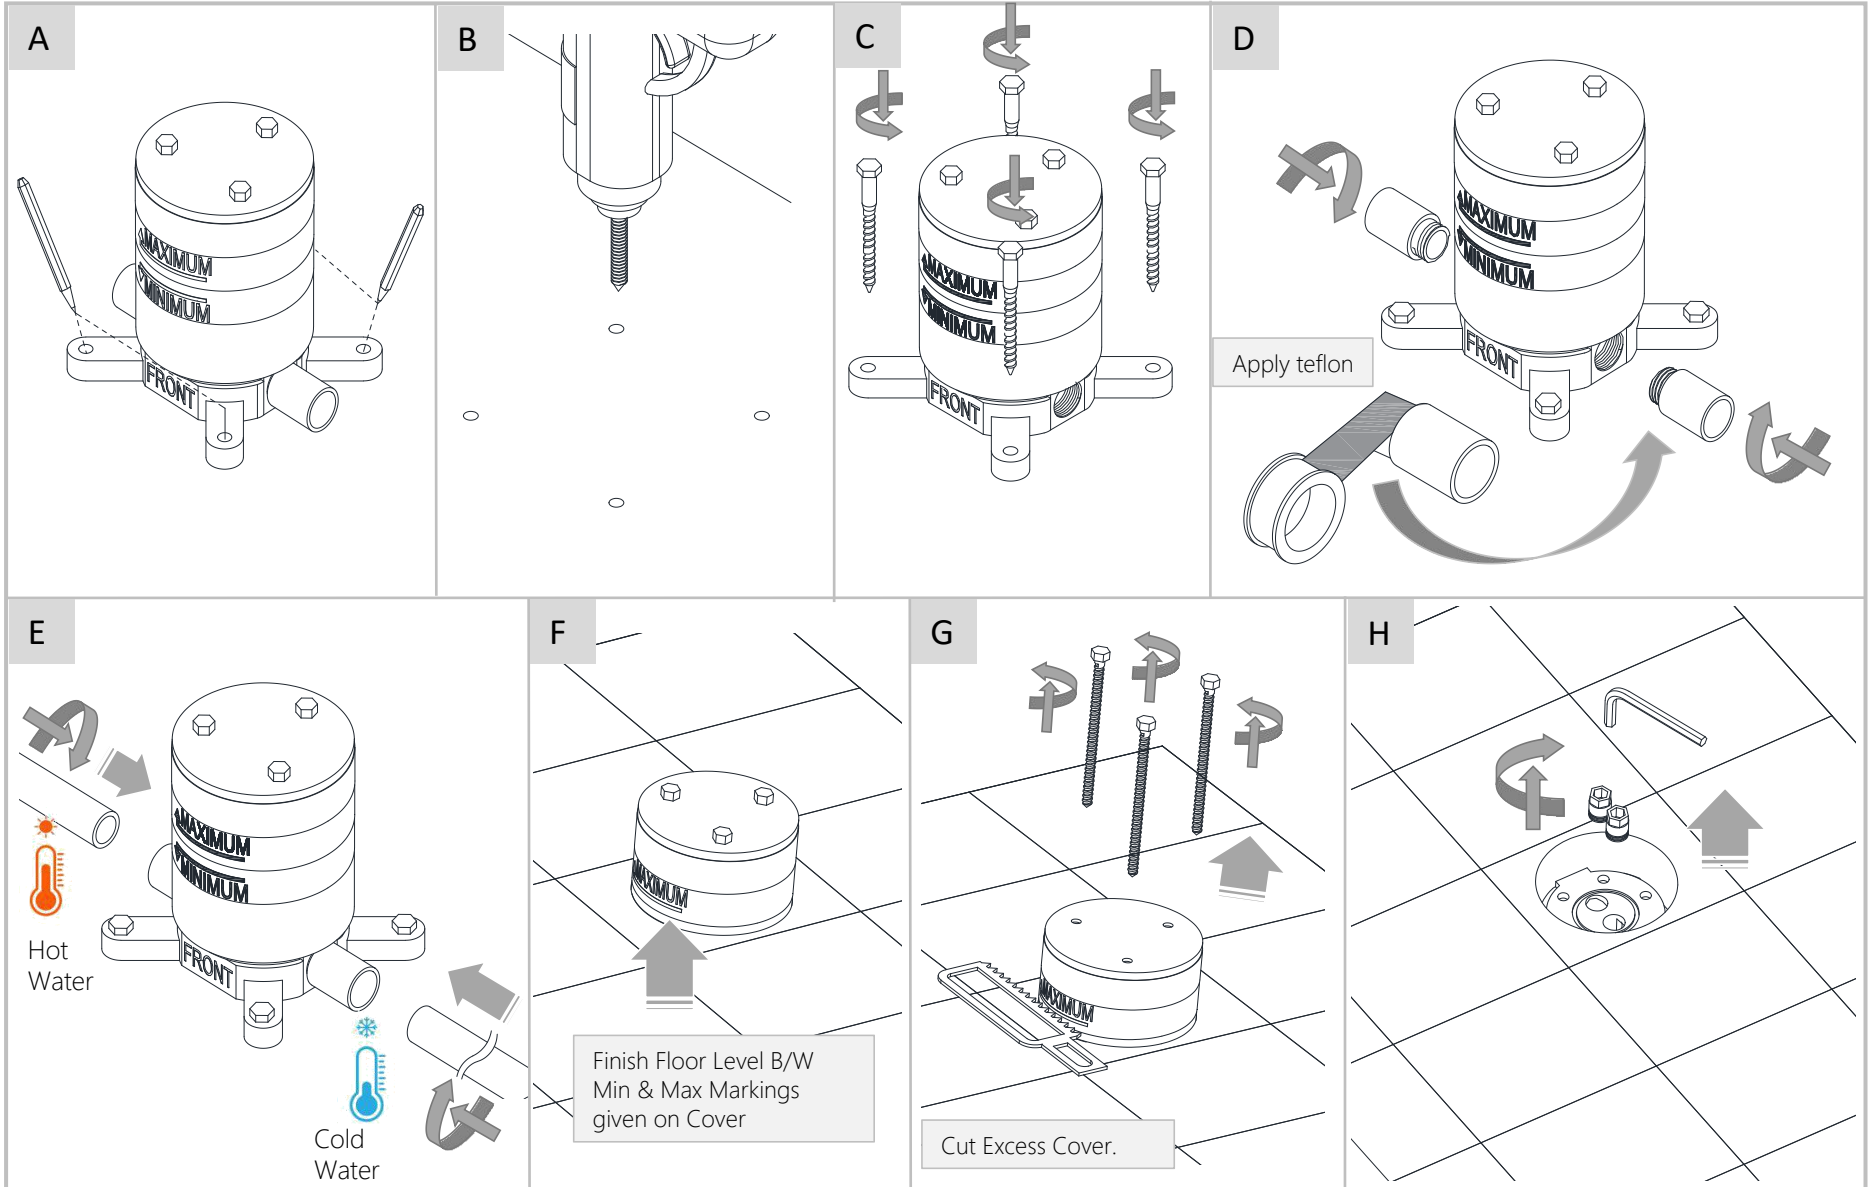

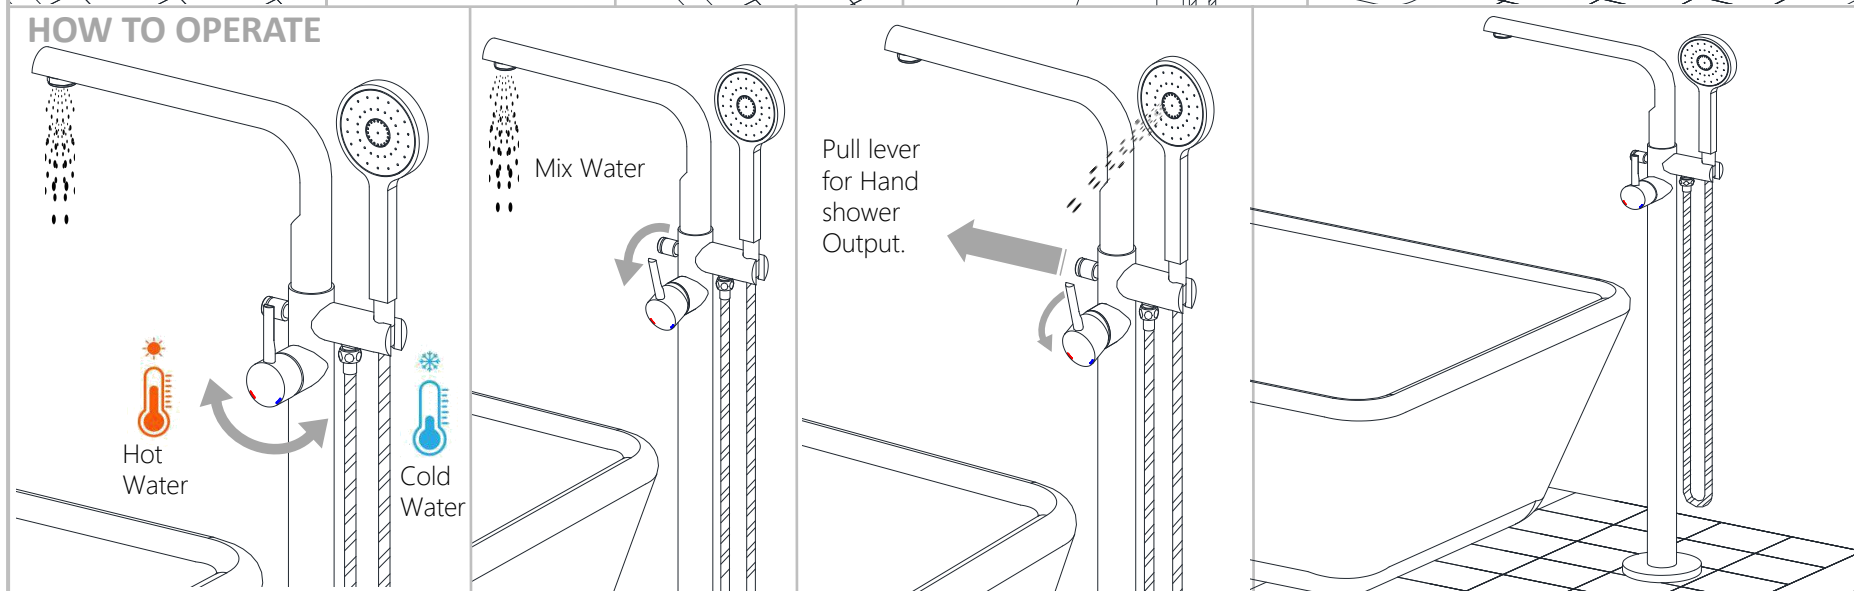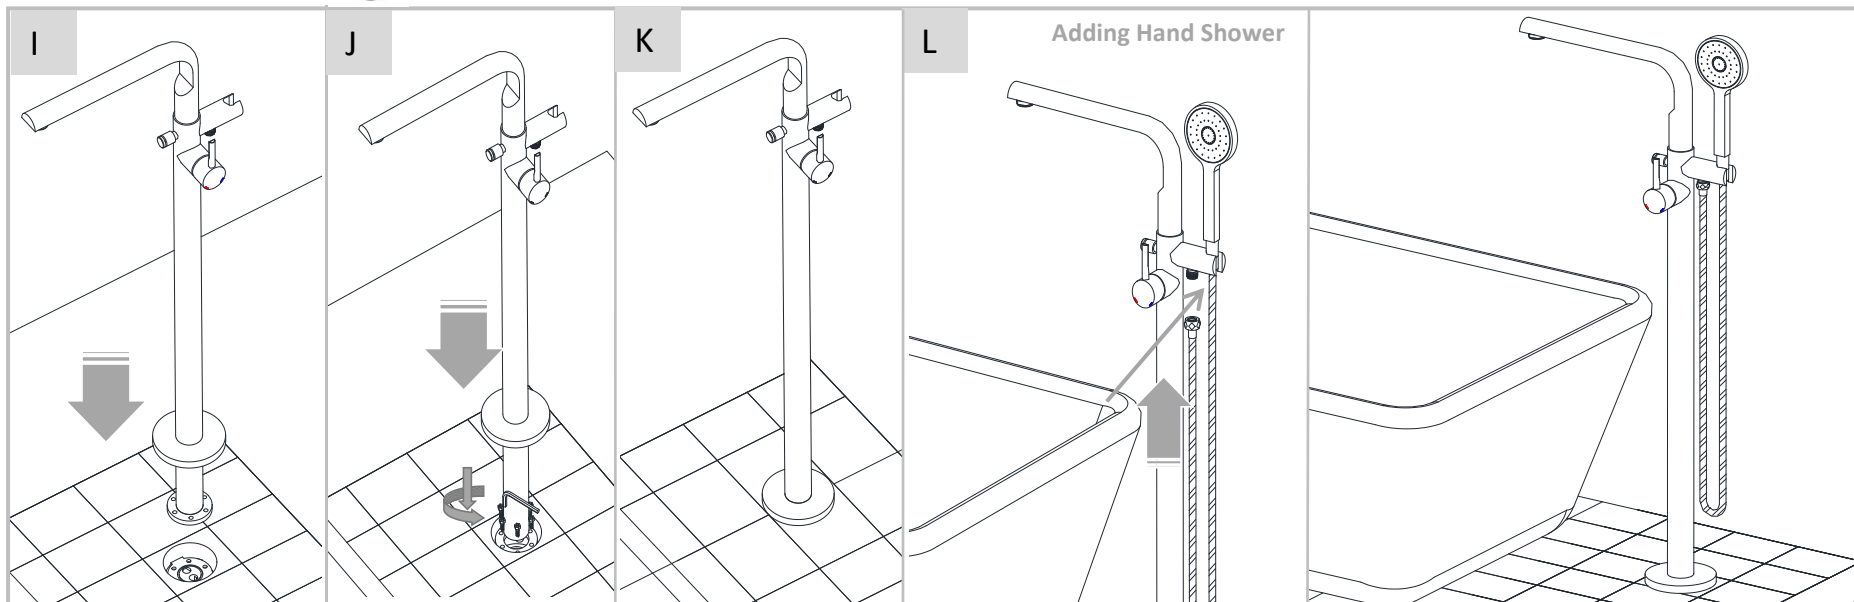


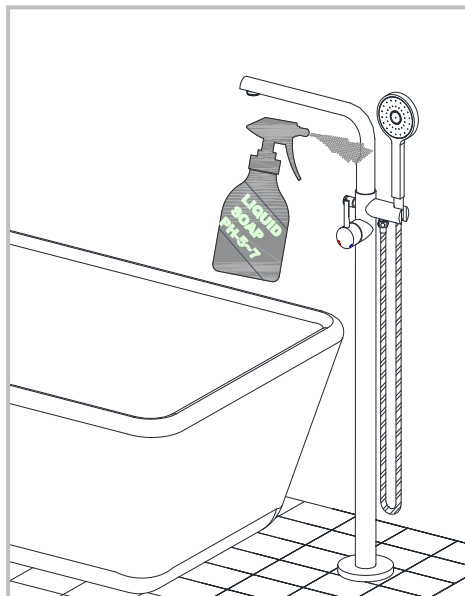

Apply soft cotton cloth

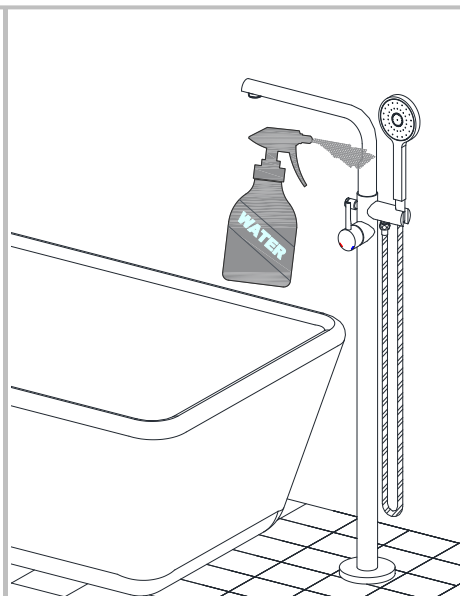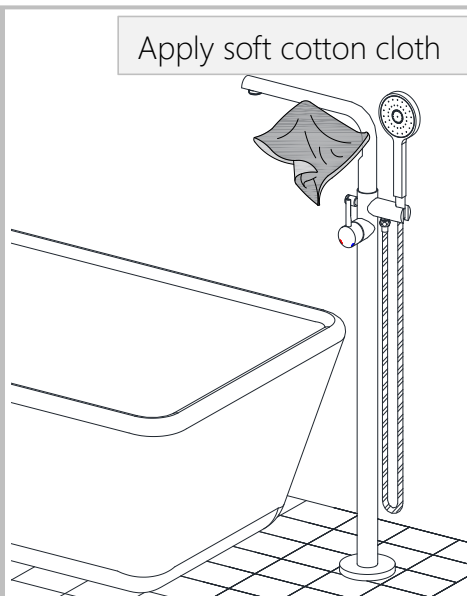

Apply soft cotton cloth

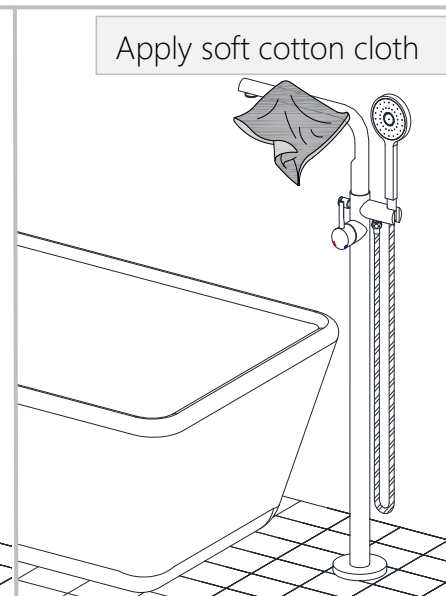


**✗ DON'T**




**✗ DON'T**

Don't apply Scrub

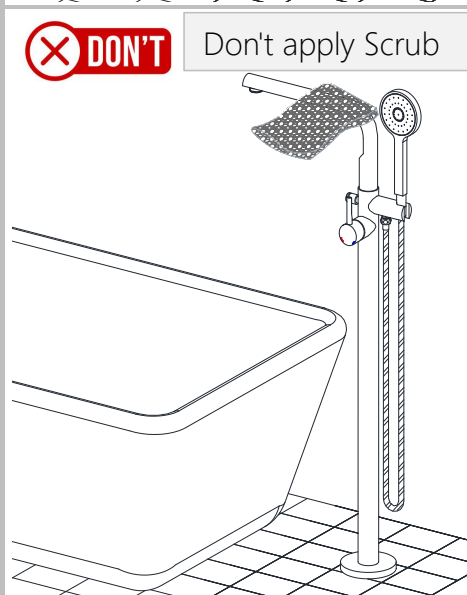

Steps & Cleaning agents requirements for Aerator Cleaning.

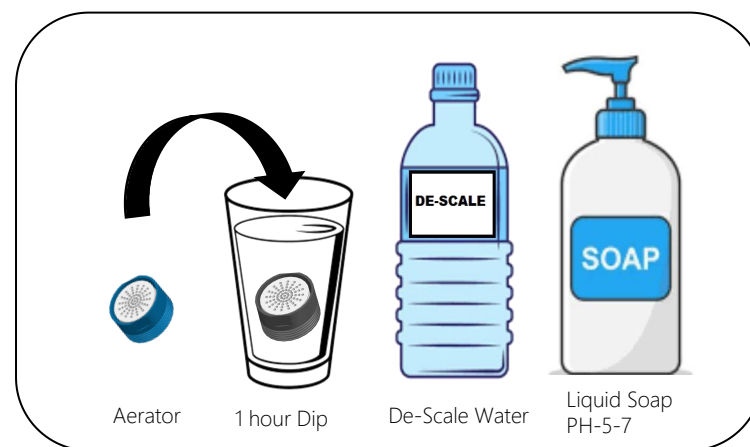

Note: Aerator Cleaning is not applicable for FLP-5149PM.